



ELUTION VOLUME (x5ml, Tris-HCl BUFFER, pH7.0)


F1G. 1

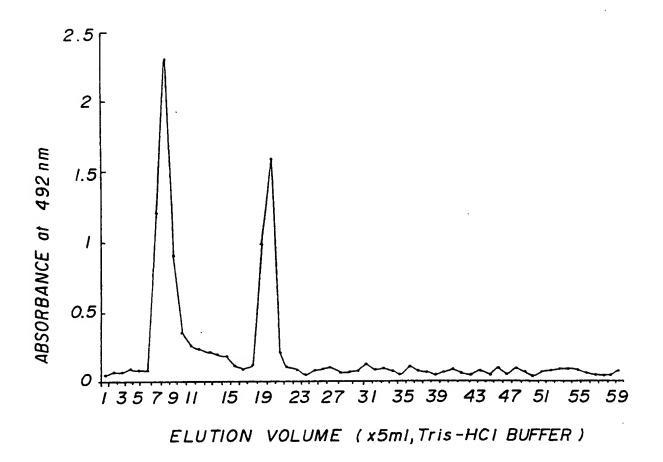


F1G. 2

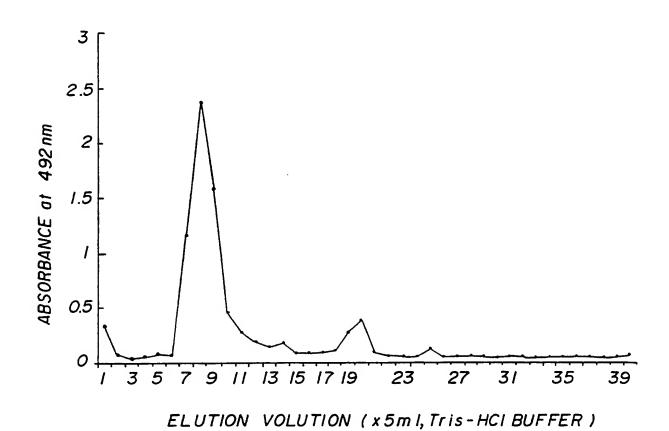

F1G. 3

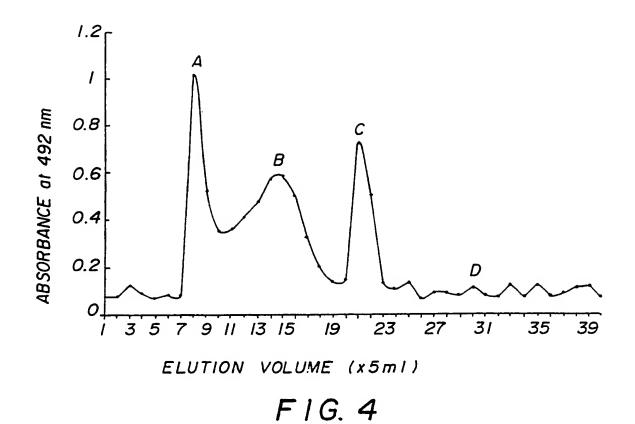


SUBSTITUTE SHEET (RULE 26)

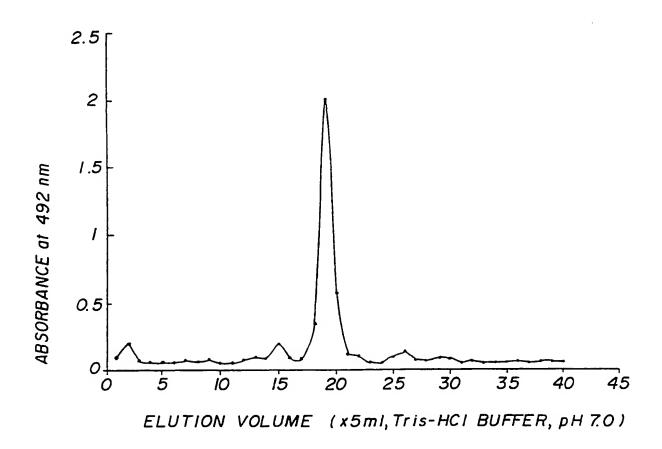


F1G. 5

6/11

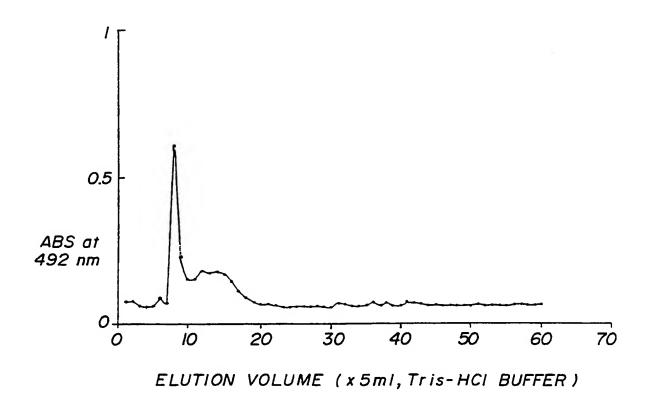

F1G. 6

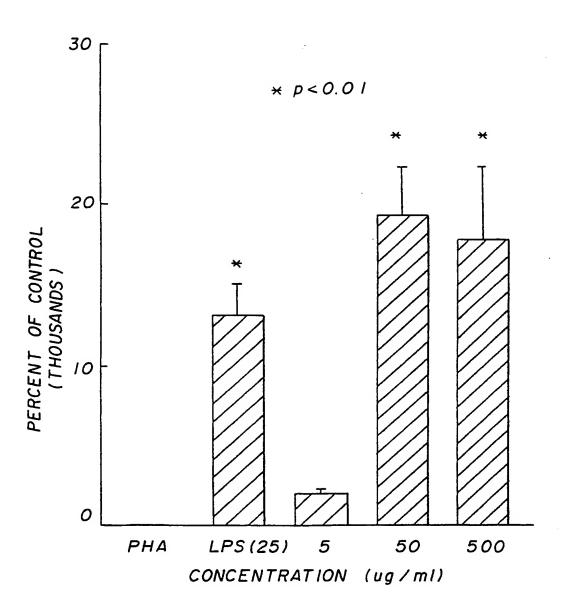

F1G. 7


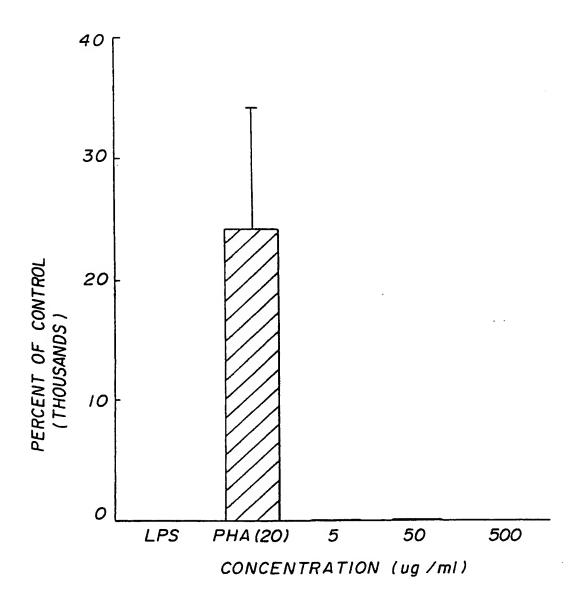


FIG. 8

9/11

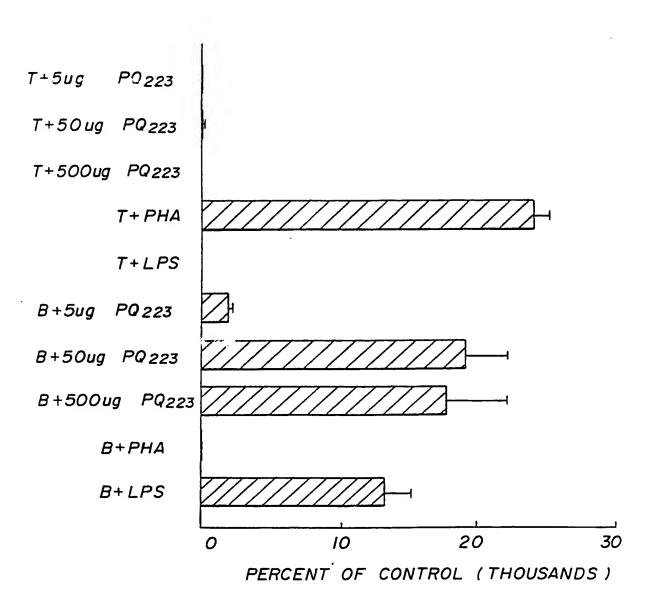

F1G. 9

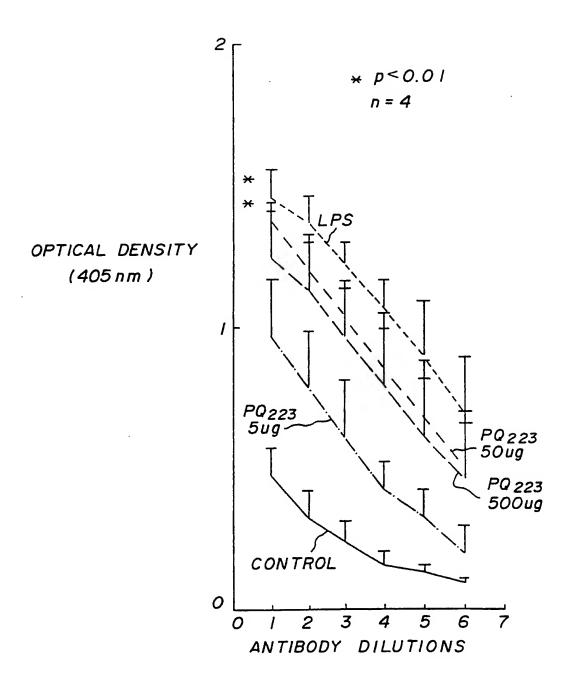


FIG. 10

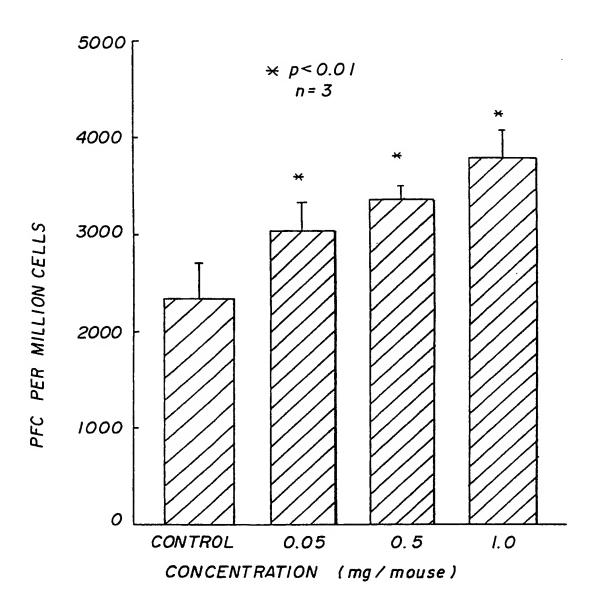


FIG. 11